

LIFT

R=42* T= A * Lift type 43# T* Intake 44= * Power type 45= E*

Date 38= 09/11/1963* H.P. 46= 15.*

LOGS

R=198* T= A * Log 199# 0* Top 200= 0.* Bot 201= 1200.*
R=198* T= A * Log 199# E* Top 200= 8.* Bot 201= 1057.*
R=189* T= A * E Log No. 190# 014* 191= M I S S D I S T*

AQUIFERS

R=114* T= A * Year 115# 1967* Type 120= B*

R=90* T= A * 256# 1* Top 91= 1002.* Bot 92= 1162.*

Unit ID 93= 124WLCXL* Name of Unit Lower Wilcox

R=90* T= A * 256# 1* Top 91= * Bot 92= *

Unit ID 93= * Name of Unit

HYDRAULICS

R=98* T= A * 99# 1* Unit tested 100= 124WLCXL* 103= A*

R=105* T= A * 99# 1* Test No. 106# 1*

107= 1537.5* Transmissivity (gal/d)/ft 115,000


108= 96.* Hydraul. cond. (gal/d)/ft² 720

110= 0.0005* Storage coeff. Boundaries 00005

800' of 8" cemented

Bill Opley

E1 PEARL R IND SCHOOL

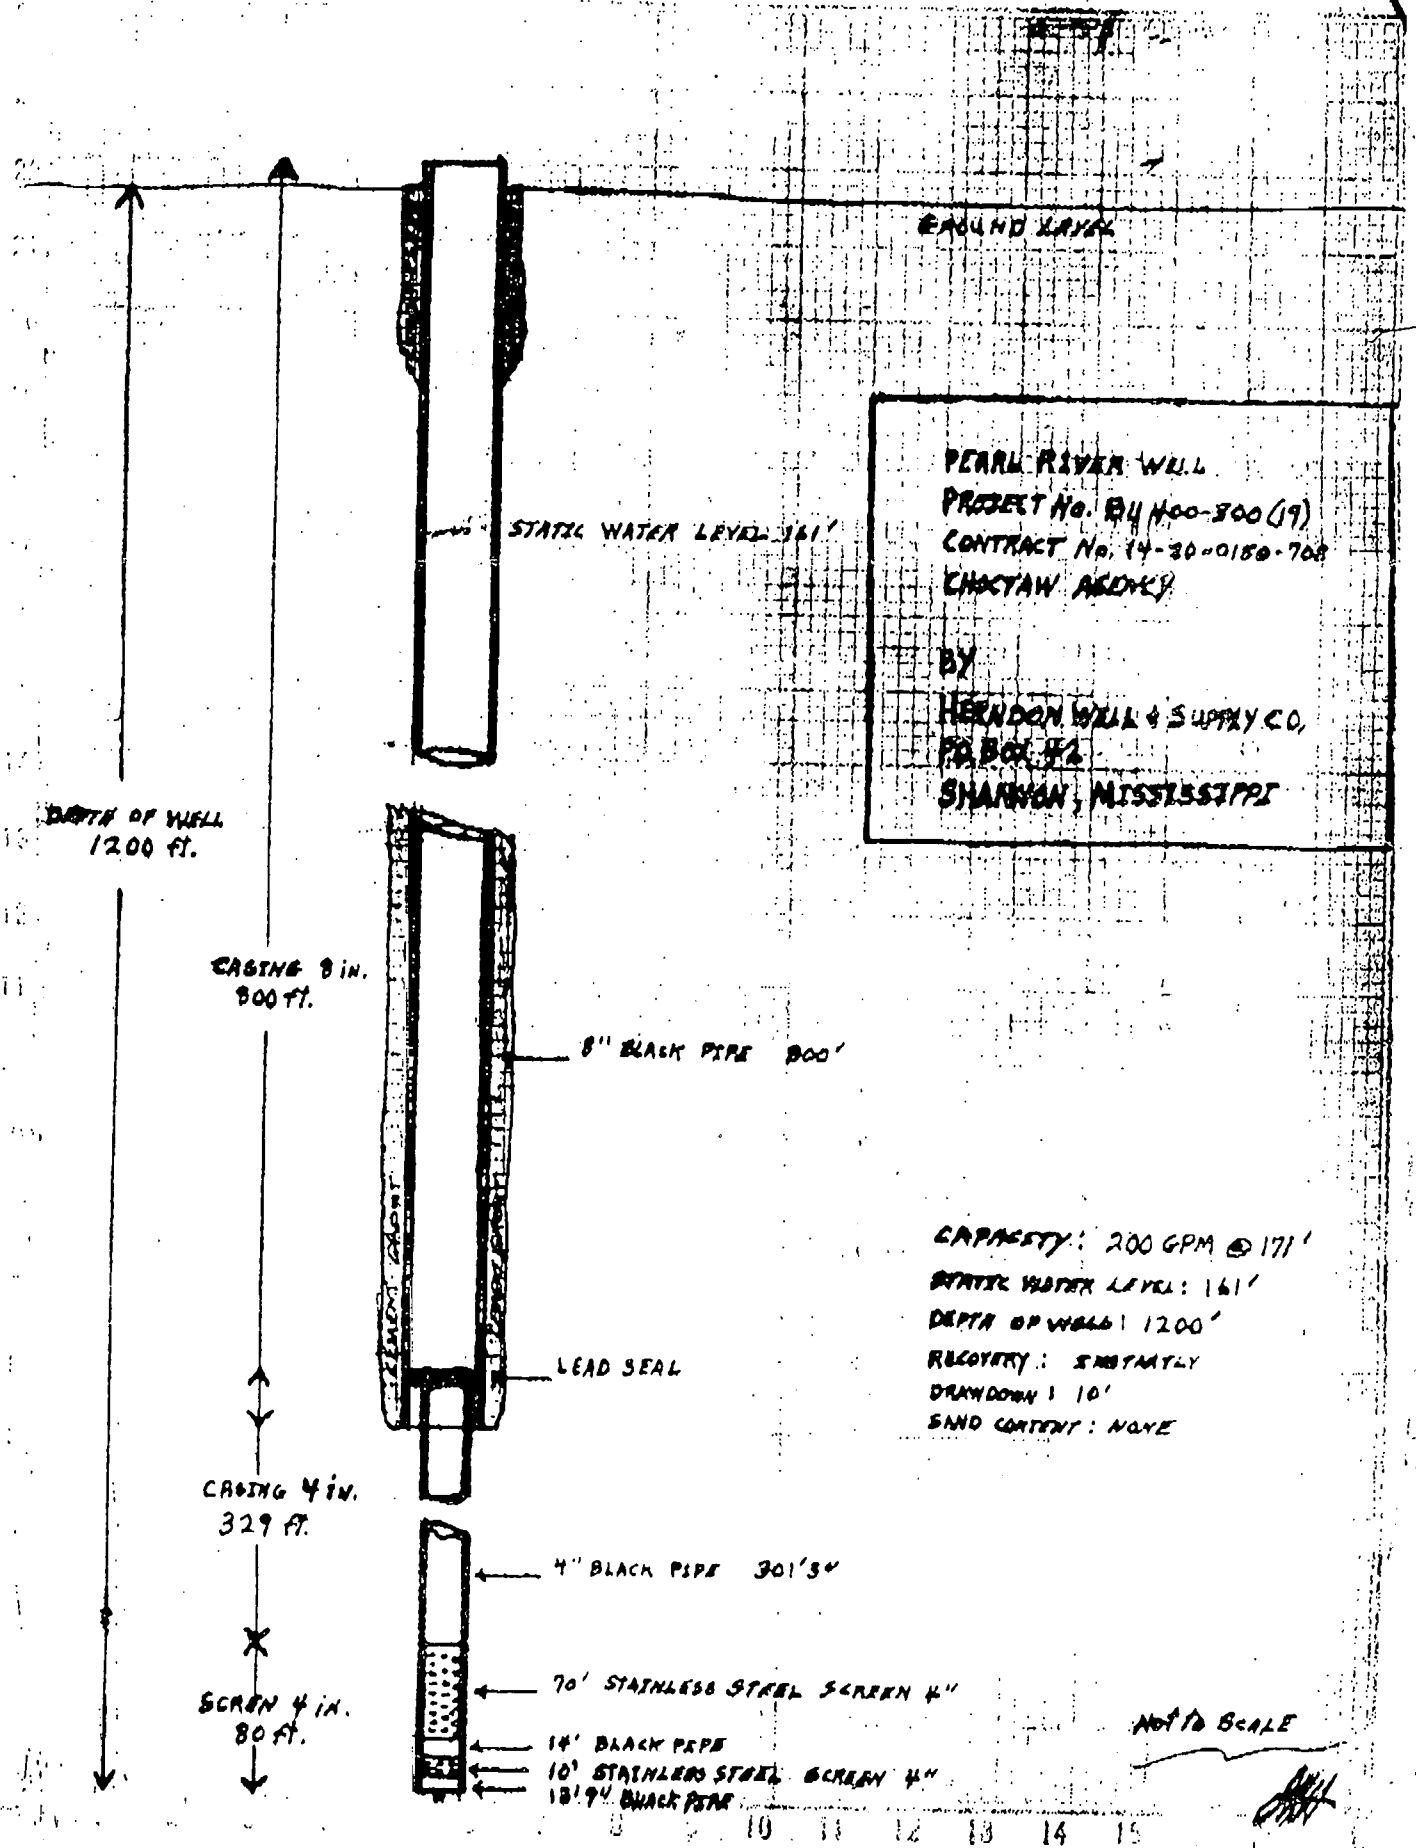

PEARL RIVER WELL
 PROJECT No. 84400-800 (19)
 CONTRACT No. 14-30-0150-700
 CHACTAW AGENCY
 BY
 HERNDON WELL & SUPPLY CO.
 P.O. BOX #2
 SHARON, MISSISSIPPI

CAPACITY: 200 GPM @ 171'
 STATIC WATER LEVEL: 161'
 DEPTH OF WELL: 1200'
 RECOVERY: SUBSTANTIAL
 DRAWDOWN: 10'
 SAND CONTENT: NONE

NOT TO SCALE

[Handwritten signature]